



## All Incidents by Day of Week For Week of May 5-11, 2013

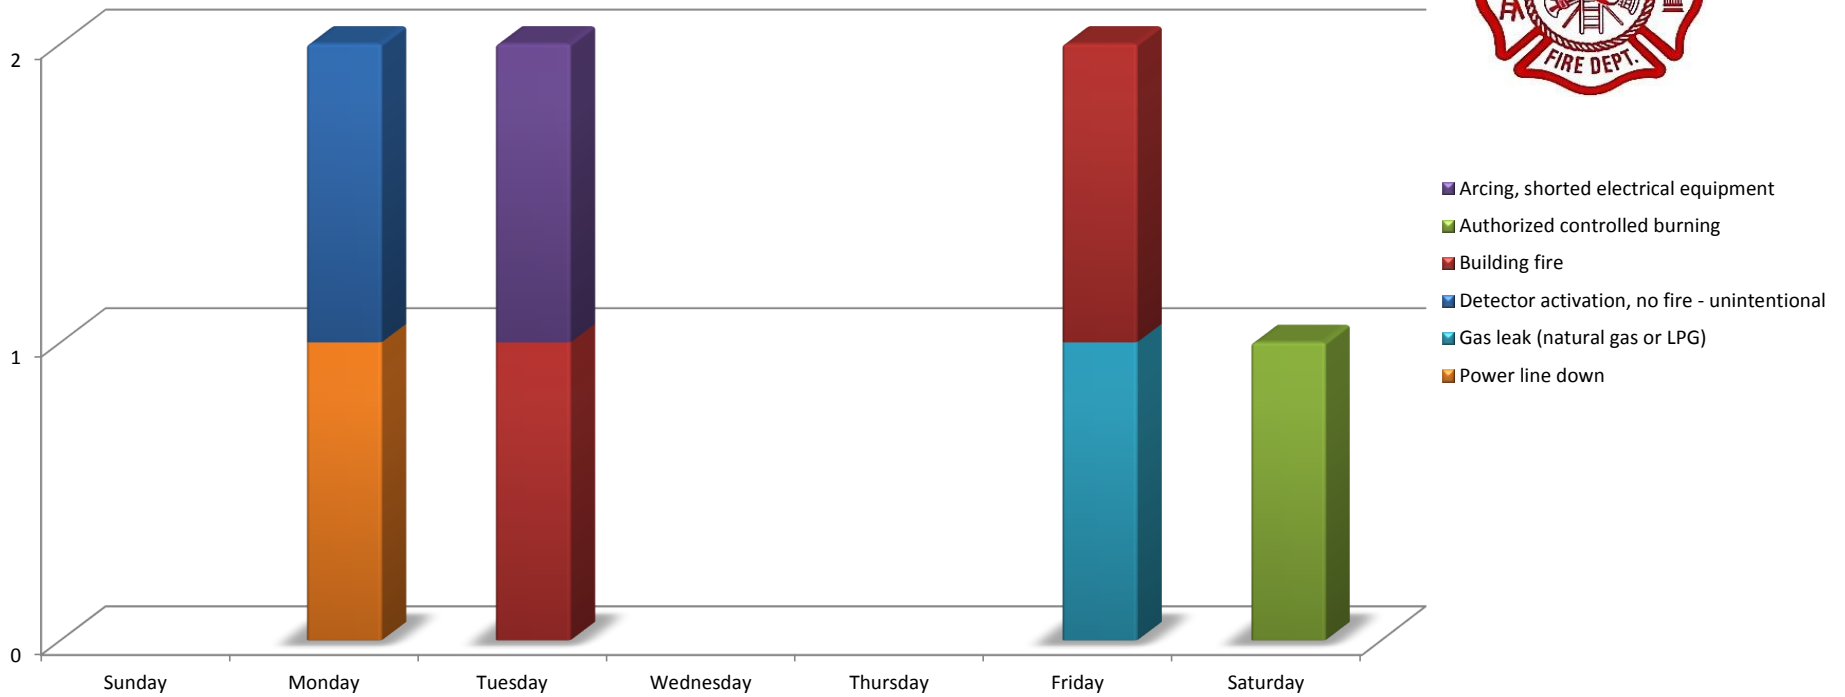


Primary Type of Situation	Sunday	Monday	Tuesday	Wednesday	Thursday	Friday	Saturday	Total
Arcing, shorted electrical equipment			1					1
Authorized controlled burning							1	1
Building fire			1			1		2
Detector activation, no fire - unintentional		1						1
Gas leak (natural gas or LPG)						1		1
Power line down		1						1
<b>Totals</b>	<b>0</b>	<b>2</b>	<b>2</b>	<b>0</b>	<b>0</b>	<b>2</b>	<b>1</b>	<b>7</b>

## All Incidents by Day of Week For Week of May 12-18, 2013

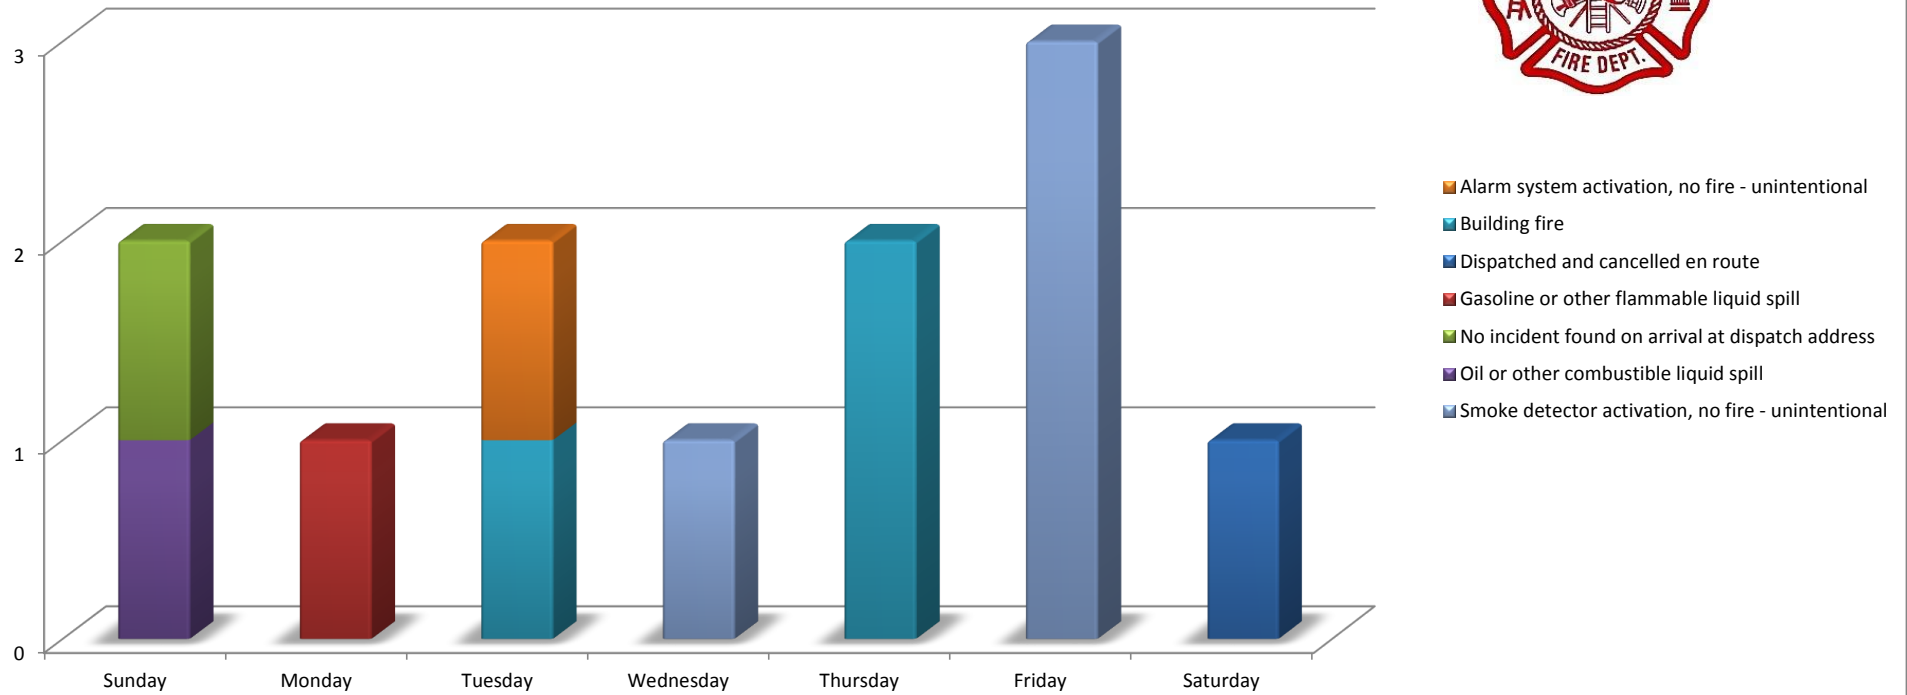


Primary Type of Situation	Sunday	Monday	Tuesday	Wednesday	Thursday	Friday	Saturday	Total
Alarm system activation, no fire - unintentional			1					1
Building fire			1		2			3
Dispatched and cancelled en route							1	1
Gasoline or other flammable liquid spill		1						1
No incident found on arrival at dispatch address	1							1
Oil or other combustible liquid spill	1							1
Smoke detector activation, no fire - unintentional				1		3		4
<b>Totals</b>	<b>2</b>	<b>1</b>	<b>2</b>	<b>1</b>	<b>2</b>	<b>3</b>	<b>1</b>	<b>12</b>

### All Incidents by Day of Week For Week of May 19-25, 2013

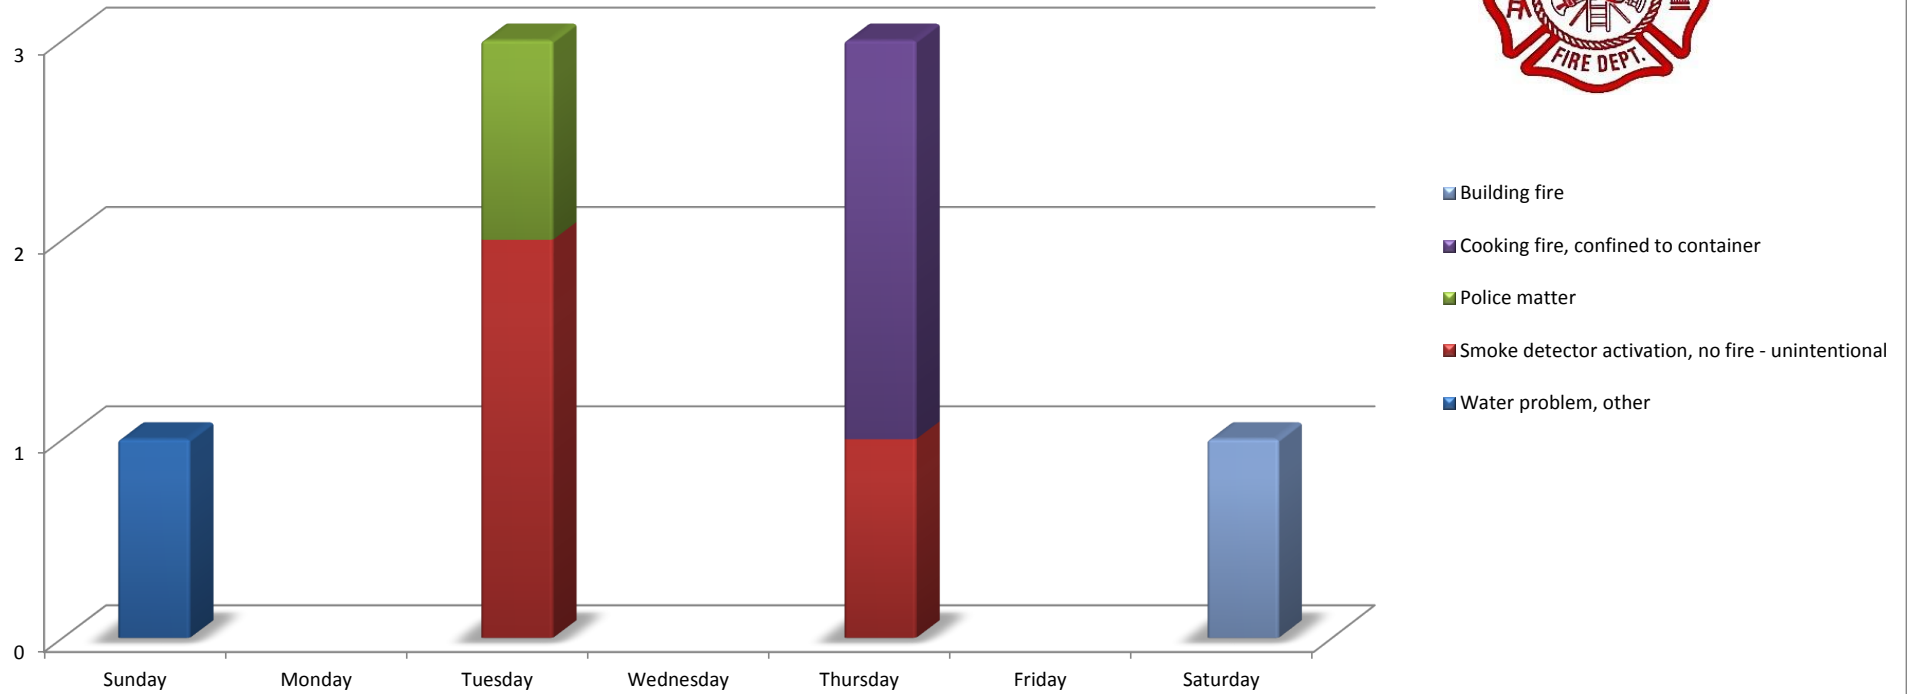

Primary Type of Situation	Sunday	Monday	Tuesday	Wednesday	Thursday	Friday	Saturday	Total
Building fire							1	1
Cooking fire, confined to container					2			2
Police matter			1					1
Smoke detector activation, no fire - unintentional			2		1			3
Water problem, other	1							1
<b>Totals</b>	<b>1</b>	<b>0</b>	<b>3</b>	<b>0</b>	<b>3</b>	<b>0</b>	<b>1</b>	<b>8</b>

### All Incidents by Day of Week For Week of May 26 - June 1, 2013

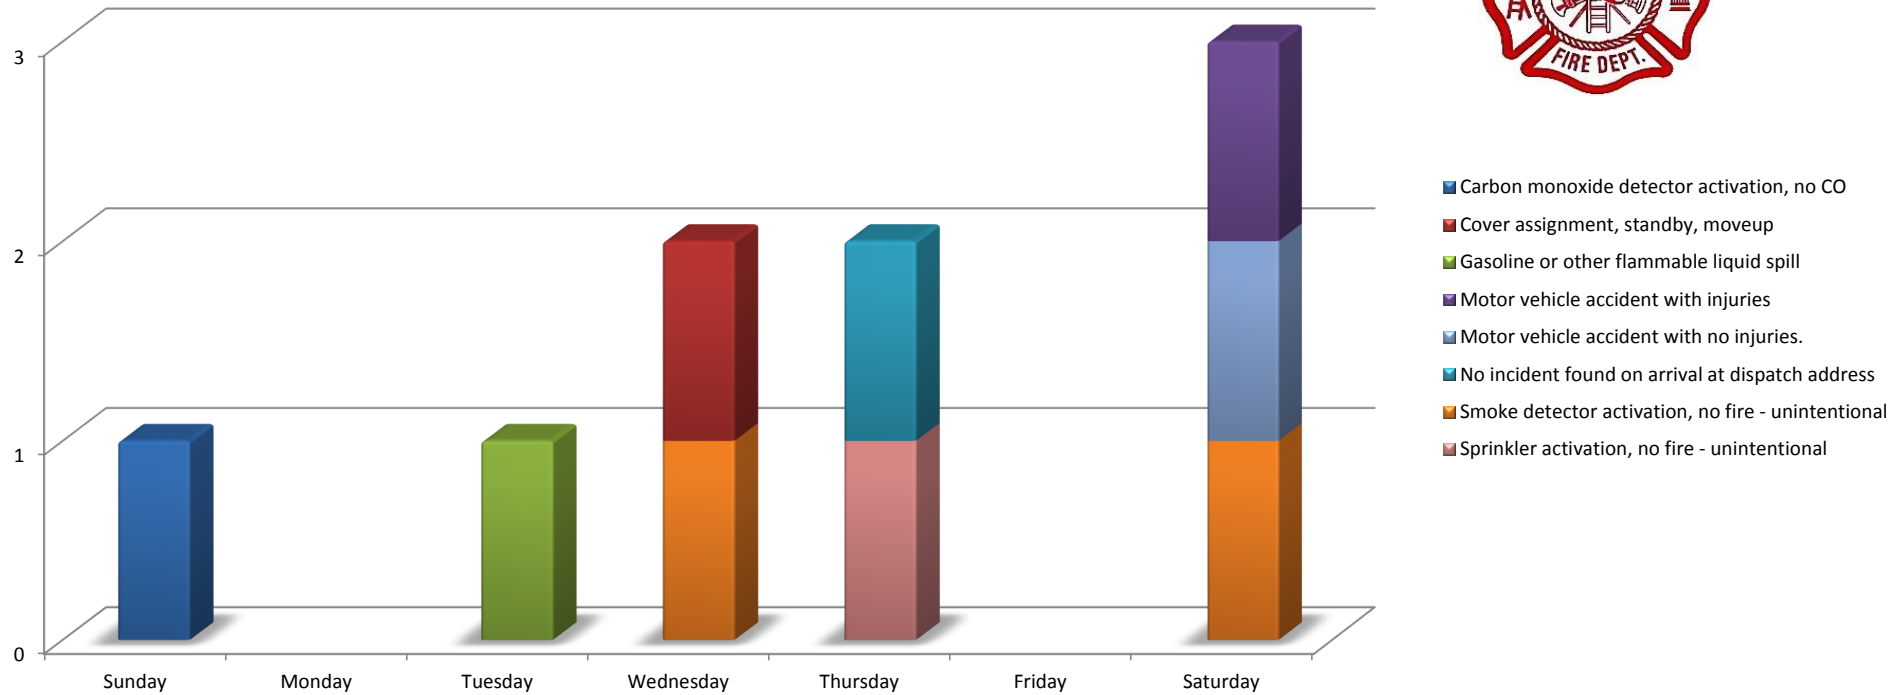

Primary Type of Situation	Sunday	Monday	Tuesday	Wednesday	Thursday	Friday	Saturday	Total
Carbon monoxide detector activation, no CO	1							1
Cover assignment, standby, moveup				1				1
Gasoline or other flammable liquid spill			1					1
Motor vehicle accident with injuries							1	1
Motor vehicle accident with no injuries.							1	1
No incident found on arrival at dispatch address					1			1
Smoke detector activation, no fire - unintentional				1			1	2
Sprinkler activation, no fire - unintentional					1			1
<b>Totals</b>	<b>1</b>	<b>0</b>	<b>1</b>	<b>2</b>	<b>2</b>	<b>0</b>	<b>3</b>	<b>9</b>